

QUALITY Steel Corporation

ORIFICE CAPACITIES CONVERSION UNITS

BTU/CU FT = 2.516 SPECIFIC GRAVITY = 1.52
 PRESSURE AT ORIFICE, IN. WATER COLUMN = 11
 ORIFICE COEFFICIENT = 0.9

| ORIFICE OR DRILL SIZE | ORIFICE CAPACITY BTU/HR, 11" W.C. | ORIFICE OR DRILL SIZE | ORIFICE CAPACITY BTU/HR, 11" W.C. |
|-----------------------|-----------------------------------|-----------------------|-----------------------------------|
| .008 | 519 | 51 | 36531 |
| .009 | 656 | 50 | 39842 |
| .010 | 812 | 49 | 43361 |
| .011 | 981 | 48 | 46983 |
| .012 | 1169 | 47 | 50088 |
| 80 | 1480 | 46 | 53296 |
| 79 | 1708 | 45 | 54641 |
| 78 | 2080 | 44 | 60229 |
| 77 | 2629 | 43 | 64369 |
| 76 | 3249 | 42 | 71095 |
| 75 | 3581 | 41 | 74924 |
| 74 | 4119 | 40 | 78029 |
| 73 | 4678 | 39 | 80513 |
| 72 | 5081 | 38 | 83721 |
| 71 | 5495 | 37 | 87860 |
| 70 | 6375 | 36 | 92207 |
| 69 | 6934 | 35 | 98312 |
| 68 | 7813 | 34 | 100175 |
| 67 | 8320 | 33 | 103797 |
| 66 | 8848 | 32 | 109385 |
| 65 | 9955 | 31 | 117043 |
| 64 | 10535 | 30 | 134119 |
| 63 | 11125 | 29 | 150366 |
| 62 | 11735 | 28 | 160301 |
| 61 | 12367 | 27 | 168580 |
| 60 | 13008 | 26 | 175617 |
| 59 | 13660 | 25 | 181619 |
| 58 | 14333 | 24 | 187828 |
| 57 | 15026 | 23 | 192796 |
| 56 | 17572 | 22 | 200350 |
| 55 | 21939 | 21 | 205525 |
| 54 | 24630 | 20 | 210699 |
| 53 | 28769 | 19 | 223945 |
| 52 | 32805 | 18 | 233466 |

| Multiply | By | To Obtain |
|------------------------------|---------|------------------------------|
| PRESSURE | | |
| Grams per square centimeter | 0.0142 | pounds per square inch |
| Inches of mercury | 0.4912 | pounds per square inch |
| Inches of mercury | 1.133 | feet of water |
| Inches of water | 0.0361 | pounds per square inch |
| Inches of water | 0.0735 | inches of mercury |
| Inches of water | 0.5781 | ounces per square inch |
| Inches of water | 5.204 | pounds per square foot |
| KPA | 100 | BAR |
| Kilograms per sq. centimeter | 14.22 | pounds per square inch |
| Kilograms per square meter | 0.2048 | pounds per square foot |
| Pounds per square inch | 0.06804 | atmospheres |
| Pounds per square inch | 0.07031 | kilograms per sq. centimeter |
| Pounds per square inch | .145 | KPA |
| Pounds per square inch | 2.036 | inches of mercury |
| Pounds per square inch | 2.307 | feet of water |
| Pounds per square inch | 14.5 | BAR |
| Pounds per square inch | 27.67 | inches of water |
| LENGTH | | |
| Centimeters | 0.3937 | inches |
| Feet | 0.3048 | meters |
| Feet | 30.48 | centimeters |
| Feet | 304.8 | millimeters |
| Inches | 2.540 | centimeters |
| Inches | 25.40 | millimeters |
| Kilometer | 0.6214 | miles |
| Meters | 1.094 | yards |
| Meters | 3.281 | feet |
| Meters | 39.37 | inches |
| Miles (nautical) | 1,853.0 | meters |
| Miles (statute) | 1,609.0 | meters |
| Yards | 0.9144 | meters |
| Yards | 91.44 | centimeters |

SEE OTHER SIDE FOR MORE CONVERSION UNITS



QUALITY STEEL
 Because Quality Steel Means Quality Tanks
 ★ Thank You for Supporting USA Manufacturers ★

West Jordan, UT Facility
 5601 Axel Park Rd.
 West Jordan, UT 84081
 Phone (801) 280-1133

Fremont, OH Facility
 721 Graham Drive
 Fremont, OH 43420
 Phone: (419) 334-2664

Inside Sales / Customer Service
 Phone (800) 445-6709
 (800) 568-2657
 Fax (717) 763-5081

Corporate Office
 PO Box 249 2914 Hwy 61
 Cleveland, MS 38732
 PHONE: (800) 345-2495
 FAX: (662) 843-4048

www.propanetank.com

PIPE AND TUBING SIZING

SIZING BETWEEN SINGLE OR SECOND STAGE (LOW PRESSURE REGULATOR) AND APPLIANCE

Maximum undiluted propane capacities listed are based on 11" W.C. setting and a 0.5" W.C. pressure drop — Capacities in 1,000 BTU/HR

CONVERTING VOLUMES OF GAS (CFH to CFH or CFM to CFM)

| Multiply Flow of: | By | To Obtain Flow of: |
|-------------------|-------|--------------------|
| Air | 0.707 | Butane |
| | 1.290 | Natural Gas |
| | 0.808 | Propane |
| Butane | 1.414 | Air |
| | 1.826 | Natural Gas |
| | 1.140 | Propane |
| Natural Gas | 0.775 | Air |
| | 0.547 | Butane |
| | 0.625 | Propane |
| Propane | 1.237 | Air |
| | 0.874 | Butane |
| | 1.598 | Natural Gas |

TEMPERATURE CONVERSION

| Degrees F | Degrees C | Degrees F | Degrees C |
|-----------|-----------|-----------|-----------|
| -50 | -46 | 60 | 15.6 |
| -40 | -40 | 70 | 21.1 |
| -30 | -34 | 80 | 26.7 |
| -20 | -29 | 90 | 32.2 |
| -10 | -23 | 100 | 37.8 |
| 0 | -17.8 | 110 | 43 |
| +10 | -12.2 | 120 | 49 |
| 20 | -6.7 | 130 | 54 |
| 30 | -1.1 | 140 | 60 |
| 32 | 0 | 150 | 66 |
| 40 | +4.4 | 160 | 71 |
| 50 | 10.0 | 170 | 77 |

| PIPE OR TUBING LENGTH FEET | COPPER TUBING SIZE, OUTSIDE DIA., TYPE "L" | | | | | PIPE OR TUBING LENGTH FEET | NOMINAL PIPE SIZE, SCHEDULE 40 | | | | | |
|----------------------------|--|-------------|-------------|-------------|-------------|----------------------------|--------------------------------|-------------|------------|----------------|----------------|------------|
| | 3/8" (.315) | 1/2" (.430) | 5/8" (.545) | 3/4" (.666) | 7/8" (.785) | | 1/2" (.622) | 3/4" (.824) | 1" (1.049) | 1 1/4" (1.380) | 1 1/2" (1.610) | 2" (2.067) |
| 10 | 49 | 110 | 206 | 348 | 536 | 10 | 291 | 608 | 1146 | 2353 | 3525 | 6789 |
| 20 | 34 | 76 | 141 | 239 | 368 | 20 | 200 | 418 | 788 | 1617 | 2423 | 4666 |
| 30 | 27 | 61 | 114 | 192 | 296 | 30 | 161 | 336 | 632 | 1299 | 1946 | 3747 |
| 40 | 23 | 52 | 97 | 164 | 253 | 40 | 137 | 287 | 541 | 1111 | 1665 | 3207 |
| 50 | 20 | 46 | 86 | 146 | 224 | 50 | 122 | 255 | 480 | 985 | 1476 | 2842 |
| 60 | 19 | 42 | 78 | 132 | 203 | 60 | 110 | 231 | 435 | 892 | 1337 | 2575 |
| 70 | 17 | 39 | 72 | 121 | 187 | 80 | 94 | 198 | 372 | 764 | 1144 | 2204 |
| 80 | 16 | 36 | 67 | 113 | 174 | 100 | 84 | 175 | 330 | 677 | 1014 | 1954 |
| 90 | 15 | 34 | 63 | 106 | 163 | 125 | 74 | 155 | 292 | 600 | 899 | 1731 |
| 100 | 14 | 32 | 59 | 100 | 154 | 150 | 67 | 141 | 265 | 544 | 815 | 1569 |
| 150 | 11 | 26 | 48 | 80 | 124 | | | | | | | |

FORMULAE: Degrees C = (°F-32) X 5/9
 Degrees F = 9/5 X °C +32

TO CONVERT TO CAPACITIES IN CUBIC FEET PER HOUR DIVIDE BY 2.5
 NOTE: DIMENSIONS IN PARENTHESIS ARE THE INSIDE DIA. OF THE COPPER TUBING & INSIDE DIA. OF SCHEDULE 40 PIPE.

QUALITY Steel Corporation

| AVERAGE PROPERTIES OF PROPANE | QUALITY STEEL CORPORATION STANDARD DOMESTIC TANK SPECIFICATIONS | | | | BTU COMPARISON | | |
|---|---|----------|---------|--------------------|-------------------------|--------------|------------------|
| | Capacity | Diameter | Length | Tank Weight | COMMON FUELS | per Gal. | per Lb. |
| Formula C ₃ H ₈ | 120 gal | 24" | 68" | 257 lb | Propane | 91,547 | 21,591 |
| Boiling Point, °F -44 | 454 l | 610 mm | 1727 mm | 117 kg | Butane | 102,032 | 21,221 |
| Specific Gravity of Gas (Air =1.00)..... 1.53 | 120 gal (vert) | 30" | 54" | 260 lb | Gasoline | 110,250 | 20,930 |
| Specific Gravity of Liquid (Water=1.00)..... 0.51 | 454 l | 762 mm | 1372 mm | 118 kg | Fuel Oil | 134,425 | 16,960 |
| Lbs. per Gallon of Liquid at 60 °F 4.24 | 250 gal | 30" | 94" | 483 lb | CONVERSION UNITS | | |
| BTU per Gallon of Gas at 60 °F..... 91547 | 946 l | 762 mm | 2387 mm | 219 kg | Multiply | By | To Obtain |
| BTU per Lb. of Gas 21591 | 320 gal | 30" | 119" | 597 lb | VOLUME | | |
| BTU per Cu. Ft. of Gas at 60 °F 2516 | 1211 l | 762 mm | 3023 mm | 271 kg | Cubic centimeter | 0.06103 | cubic inches |
| Cu. Ft. of Vapor at 60 °F/Gal. of Liquid at 60 °F 36.39 | 500 gal | 37" | 119" | 949 lb | Cubic feet | 7.4805 | gallons (US) |
| Cu. Ft. of Vapor at 60 °F/Lb. of Liquid at 60 °F 8.547 | 1893 l | 940 mm | 3023 mm | 430 kg | Cubic feet | 28.316 | liters |
| Latent Heat of Vaporization at Boiling Point BTU/Gal..... 785.0 | 1000 gal | 41" | 192" | 1760 lb | Gallons (US) | 0.1337 | cubic feet |
| Combustion Data: | 3785 l | 1041 mm | 4877 mm | 799 kg | Gallons (US) | 3.785 | liters |
| Cu. Ft. Air Required to Burn 1 Cu. Ft. Gas 23.86 | 1450 gal | 47" | 208" | 2658 lb | Gallons (US) | 231 | cubic inches |
| Flash Point, °F -156 | 5488 l | 1182 mm | 5277 mm | 1205 kg | Liters | 1.057 | quarts (US) |
| Ignition Temperature in Air, °F ... 920-1020 | 1990 gal | 46" | 288" | 3521 lb | Liters | 2.113 | pints (US) |
| Maximum Flame Temperature in Air, °F 3595 | 7532 l | 1182 mm | 7283 mm | 1597 kg | MISCELLANEOUS | | |
| Limits of Inflammability, Percentage of Gas in Air Mixture: | APPROXIMATE VAPORIZATION CAPACITIES OF QSC PROPANE TANKS BTU PER HOUR WITH 40% LIQUID IN TANK DOMESTIC SYSTEMS | | | | BTU | 0.252 | calories |
| at Lower Limit—% 2.4 | | | | | Decitherm | 10,000 | BTU |
| at Upper Limit—% 9.6 | | | | | Kilogram | 2.205 | pounds |
| Octane Number (ISO-Octane =100) Over 100 | | | | | Kilowatt Hour | 3412 | BTU |
| | | | | Ounces | 28.35 | grams | |
| | | | | Pounds | 0.4536 | kilograms | |
| | | | | Pounds | 453.5924 | grams | |
| | | | | Pounds | 21,591 | LPG BTU | |
| | | | | Therm | 100,000 | BTU | |
| | | | | API Bbls | 42 | gallons (US) | |
| | | | | Gallons of Propane | 26.9 | KWH | |
| | | | | HP | 746 | KWH | |
| | | | | HP (Steam) | 42,418 | BTU | |


| VAPOR PRESSURES OF PROPANE | | | | | | | |
|----------------------------|----------|-------|----------|-------|---------|-------|---------|
| TEMP. | PRESS. | TEMP. | PRESS. | TEMP. | PRESS. | TEMP. | PRESS. |
| 130°F | 257 psig | 70°F | 109 psig | 20°F | 40 psig | -20°F | 10 psig |
| 120°F | 225 psig | 65°F | 100 psig | 10°F | 31 psig | -25°F | 8 psig |
| 110°F | 197 psig | 60°F | 92 psig | 0°F | 23 psig | -30°F | 5 psig |
| 100°F | 172 psig | 50°F | 77 psig | -5°F | 20 psig | -35°F | 3 psig |
| 90°F | 149 psig | 40°F | 63 psig | -10°F | 16 psig | -40°F | 1 psig |
| 80°F | 128 psig | 30°F | 51 psig | -15°F | 13 psig | -44°F | 0 psig |

SEE OTHER SIDE FOR MORE CONVERSION UNITS

Cleveland, MS Facility 800-345-2495
 Fremont, OH Facility 419-334-2664
 West Jordan, UT 801-280-1133
 Inside Sales & Customer Svc 800-445-6709



WEBSITE
www.propanetank.com

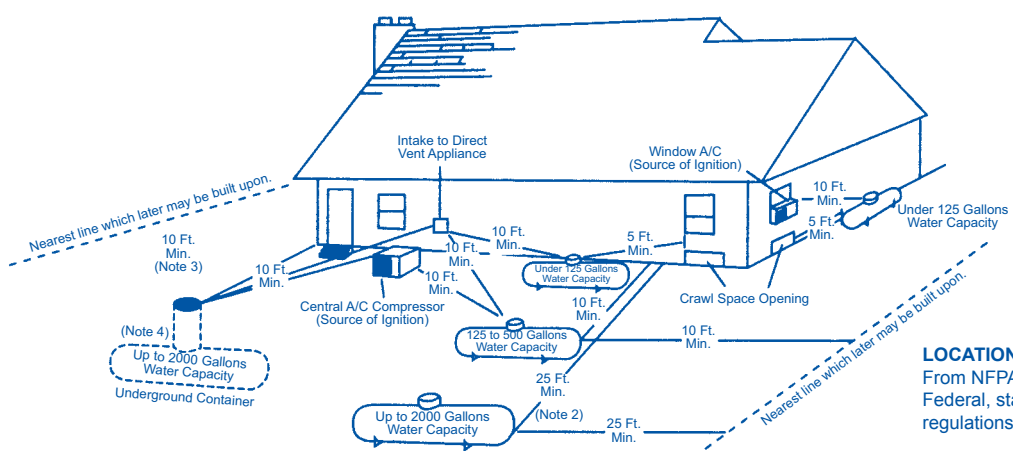

LOCATION OF ASME CONTAINERS
 From NFPA 58, Appendix I
 Federal, state, or local ordinances and regulations should be observed at all times.

- Notes:
- Regardless of its size, any ASME tank filled on-site must be located so that the filling connection and fixed liquid level gauge are at least 10 feet from external source of ignition (i.e. open flame, window A/C, compressor, etc.), intake to direct vented gas appliance or intake to a mechanical ventilation system.
 - May be reduced to 10 feet minimum for a single container of 1200 gallons water capacity or less if it is located at least 25 feet from any other LP Gas container of more than 125 gallons water capacity.
 - Minimum distances from underground containers shall be measured from the relief valve and filling or level gauge vent connection at the container, except that no part of an underground container shall be less than 10 feet from a building or line of adjoining property which may be built upon.
 - Where the container may be subject to abrasive action or physical damage due to vehicular traffic or other causes it must be either, (a) placed not less than 2 feet below grade; (b) otherwise protected against such physical damage.